


1. All 316(b) Existing Facilities for Which EPA has Location Data



This map shows the 897 cooling water intakes at the 871 facilities for which EPA has location data. In addition to these facilities, EPA estimates that another 389 facilities, or a total of 1,260 facilities withdrawing at least 2 millions gallons per day, are covered by the April 2011 proposed rule.

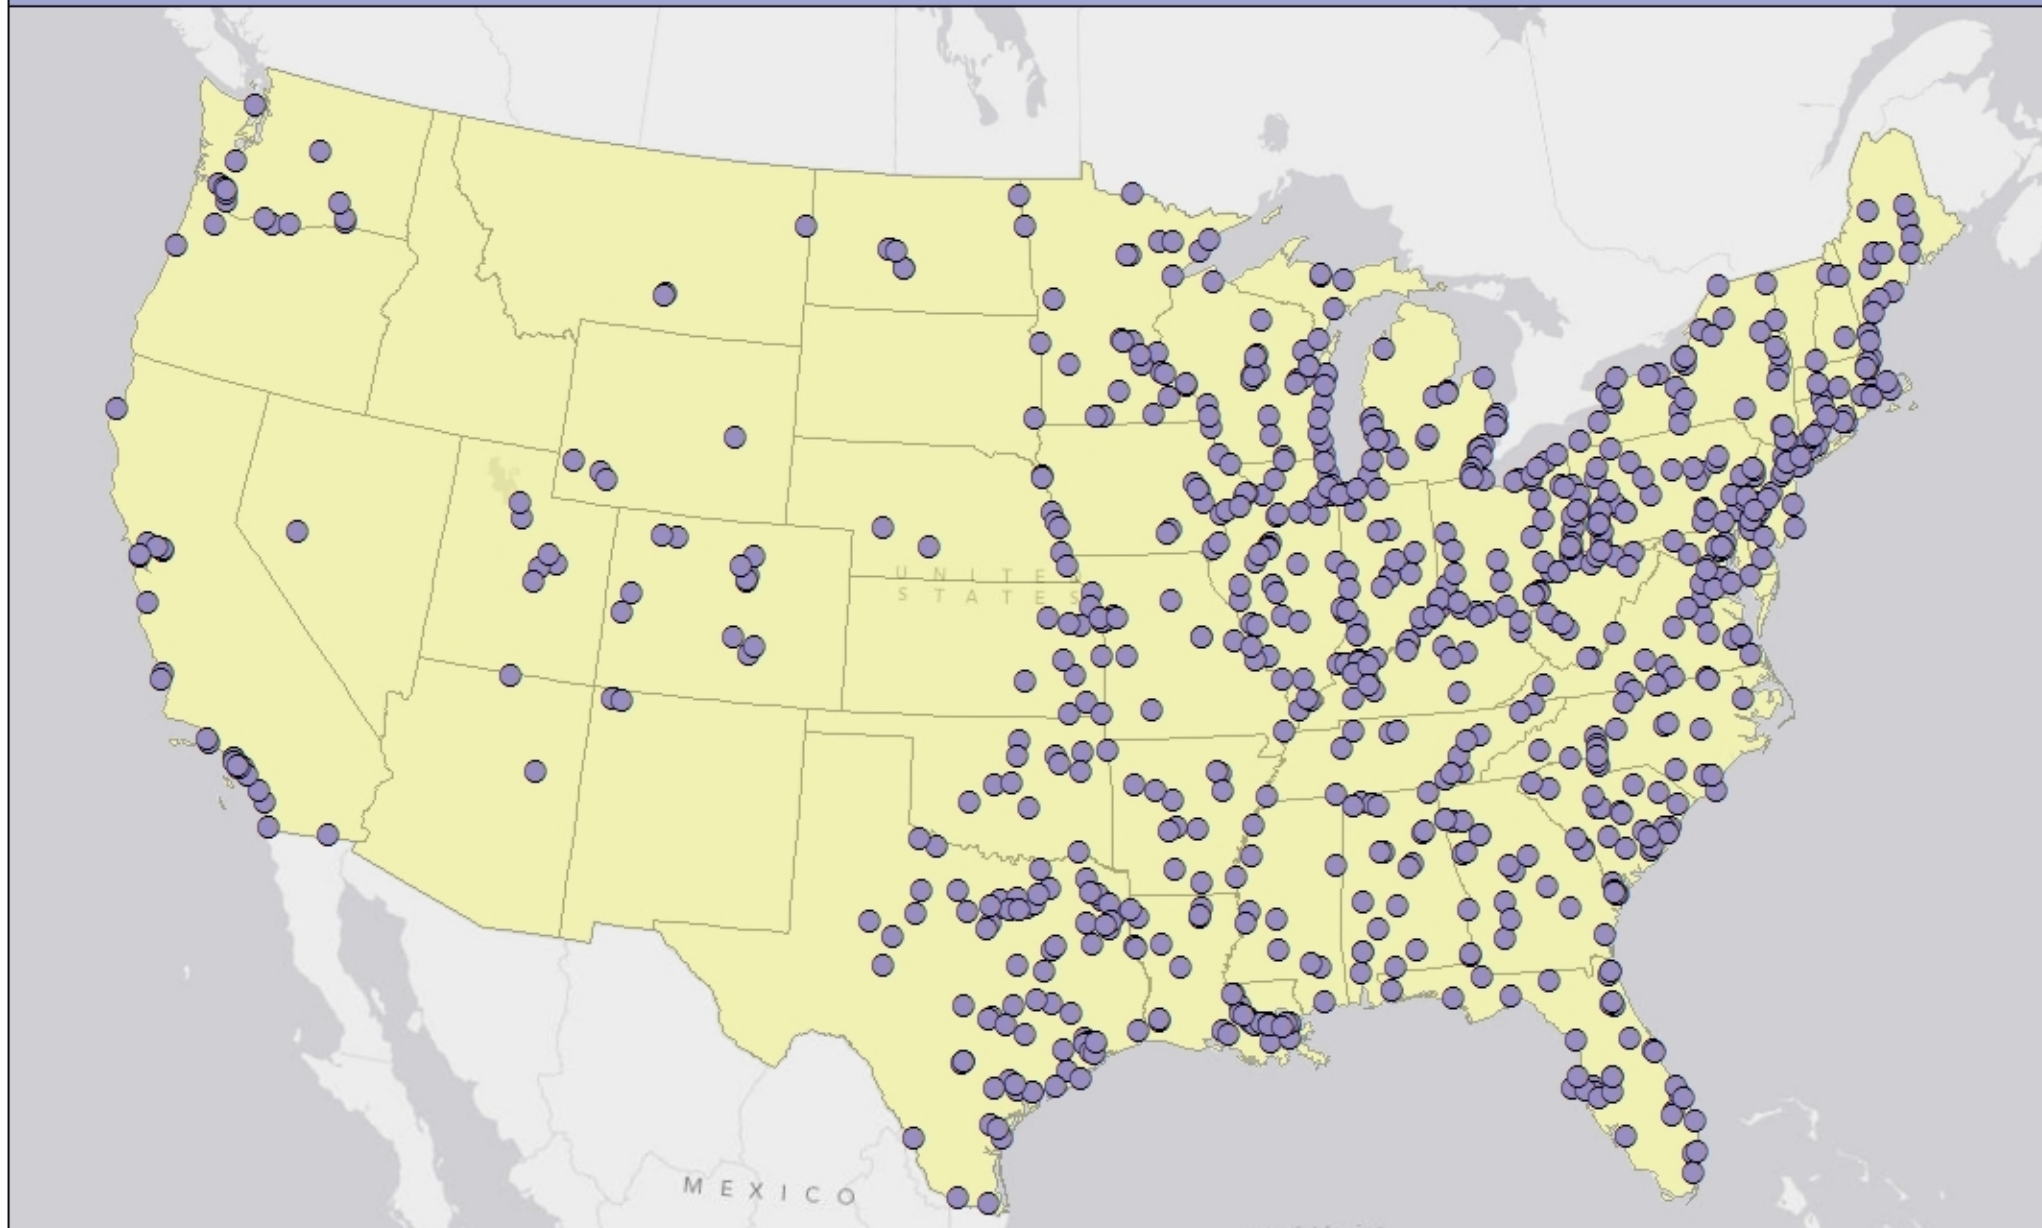